


1 2 3 4 5 6

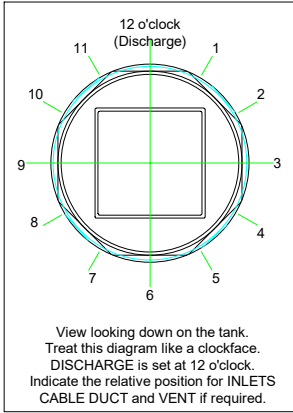


Fabrication Specifications				
ITEM	INDEX	DEPTH (mm)	DIA. (mm)	CLOCKFACE POSITION
Tank depth	A			
Tank Ø	B			
Inlet	C1		110	
Inlet	C2			
Inlet	C3			
Discharge	D		63	12
Cable duct			110	
Vent			110	

Comments

Please Note - Inlet invert should be between 400 - 1015 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

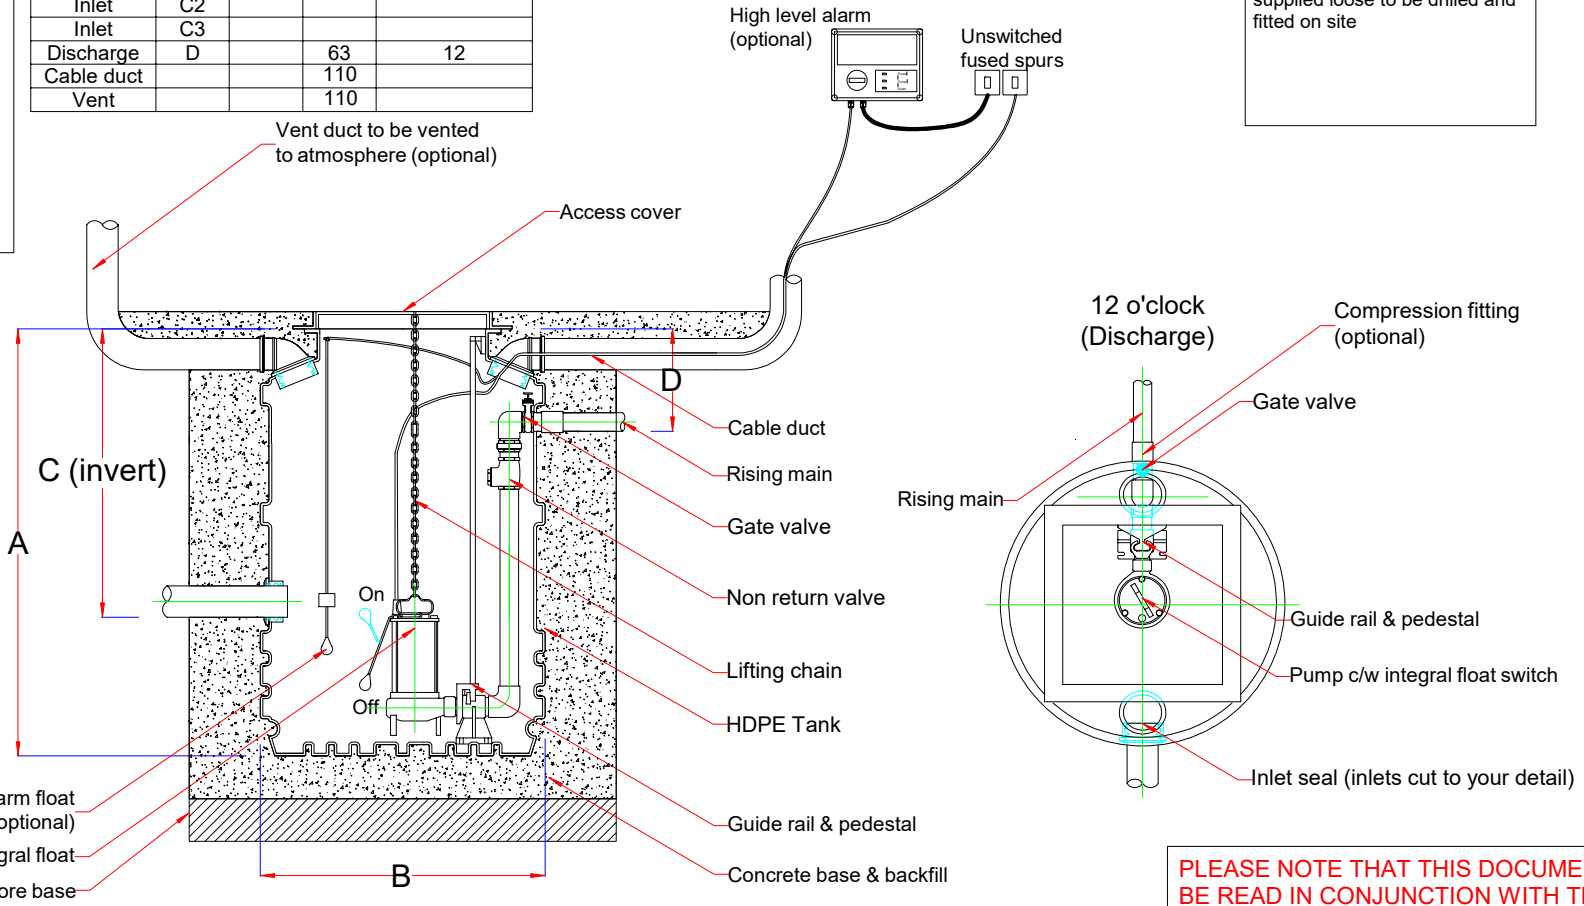

PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES

REV	DETAIL	DATE	DRAWN	TITLE
				CUSTOMER

		DRAWN	gf
THIRD ANGLE PROJECTION		SCALE	NOT TO SCALE
		SHEET	1 of 1
TOLERANCE +/- 2%		REV	0